

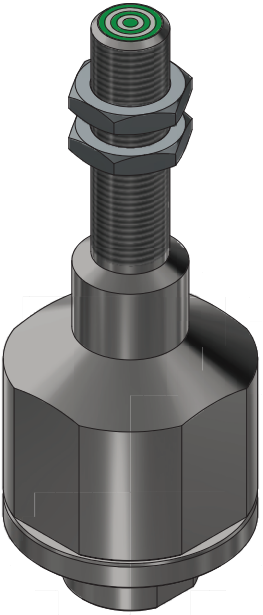


7J-13563-JSP

GO™ Switch 70 Micro Junction

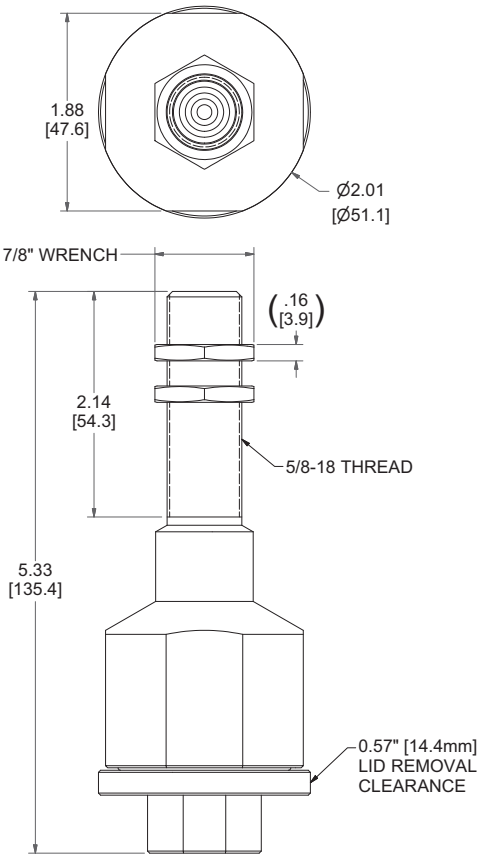

Model	7J Model
Contact Form	SPDT
Sensing Range	2.5 mm
Outlet Position	Bottom
Enclosure Material	316L SS
Area Classification	UL CI I Div 1
Wiring Option	1/2" NPT
Regional Certification	No Regional Certification
Custom field	TopWorx Certified: IP 66/67/68, NEMA 4x/6/6P

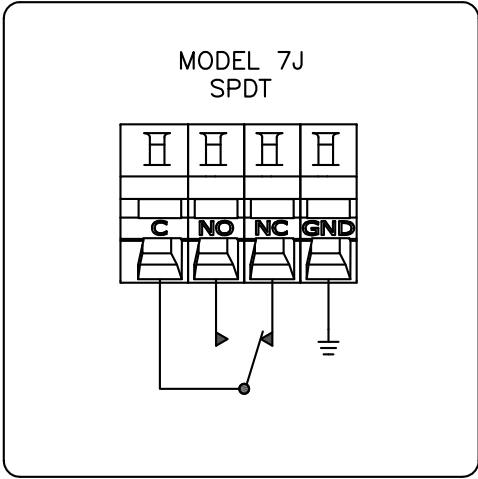

GO SWITCH



Class I, Division 1, Groups A,B,C,D Type 6,6P
Class II, Division 1, Groups E,F,G; Class III
-50°C ≤ Ta ≤ 40°C;
120VAC/4A; 24VDC/3A
Conduit: 1/2 NPT - Lead Seal Required

GO SWITCH

Current as of August 31, 2021 – Subject to change without notice.